


**IEC 60332-1 Test for selvslukkende egenskaber**

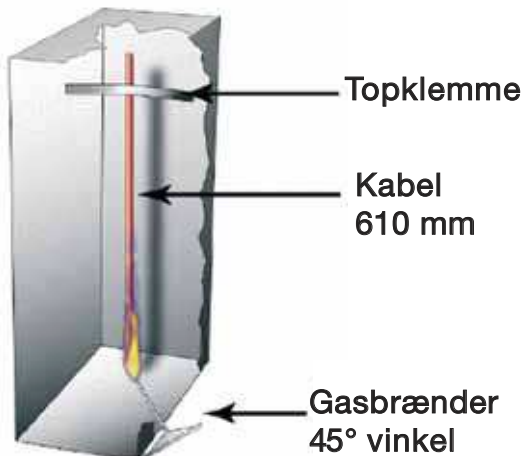


**EN 50265**

Kabeldiam (mm)	Testperiode (S)
D<25	60
25<D<50	120
50<D<75	240
75<D	480


Branden må ikke have spredt sig til mere end 50 mm fra topklemmen.

**IEC 60331 Test for at sikre funktion under brand**

- Part - 11: Apparat
- Part - 21: 1 kV Power cables
- Part - 22: Above 1 kV cables (UC)
- Part - 23: Data cables
- Part - 25: Optical fibre cables

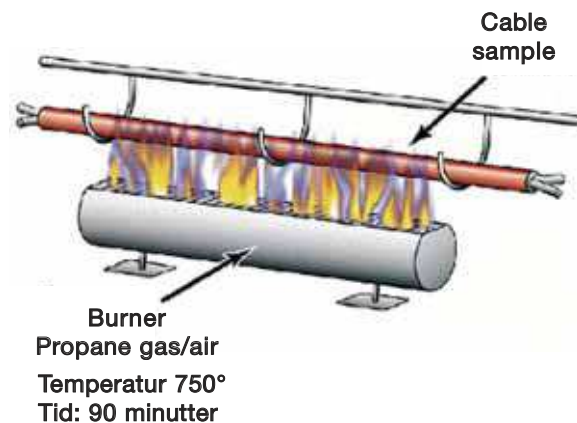

**IEC 60332-3 Test for selvslukkende kabler**

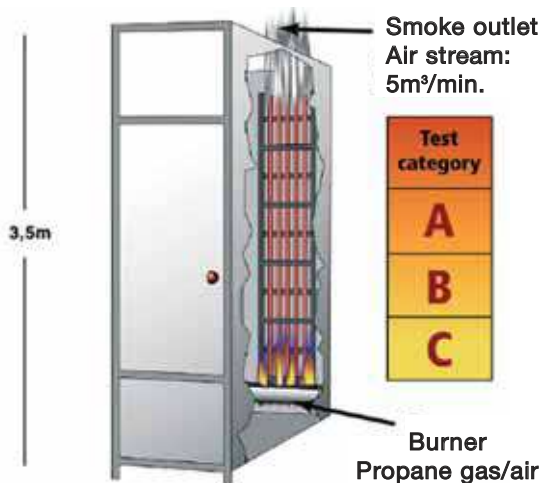

**EN 50266**

Testtid:

- Cat.: A 7,0 liter/m kabelmateriale 40 min.
- Cat.: B 3,5 liter/m kabelmateriale 40 min.
- Cat.: C 1,5 liter/m kabelmateriale 20 min.
- Cat.: D 0,5 liter/m kabelmateriale 20 min.

Testen er bestået såfremt branden ikke har bedt sig mere end 2,5 m.